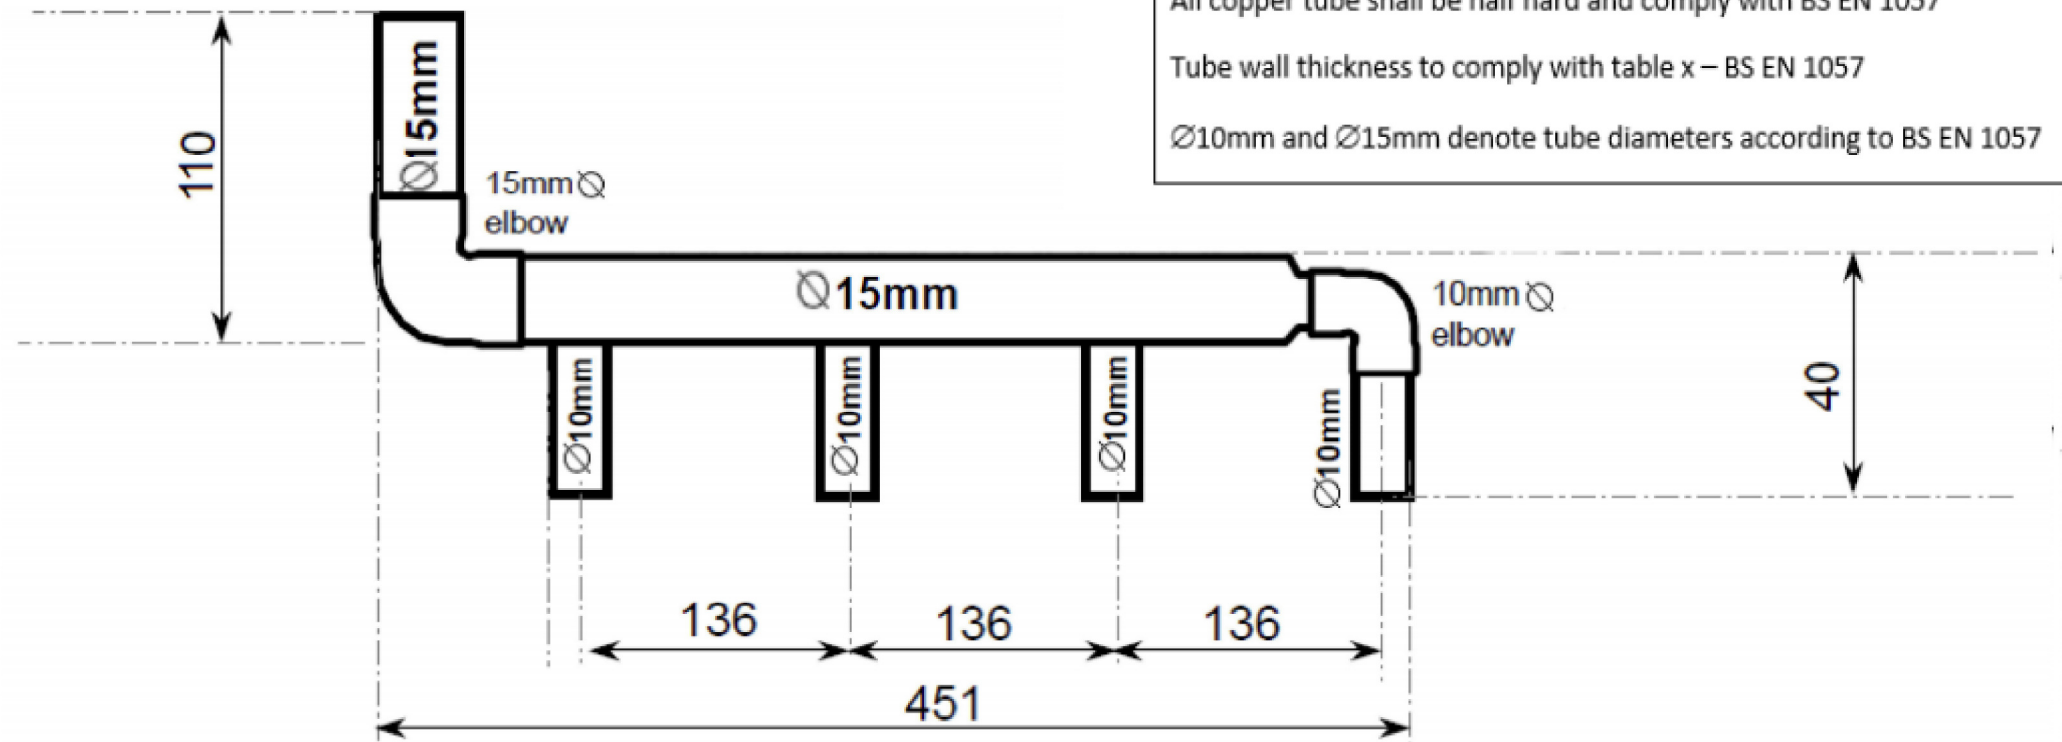


Top ManifoldNotes

All copper tube shall be half hard and comply with BS EN 1057

Tube wall thickness to comply with table x – BS EN 1057

$\text{Ø}10\text{mm}$ and $\text{Ø}15\text{mm}$ denote tube diameters according to BS EN 1057

Bottom Manifold